


ENGINEERING FACTORS

Multiply Δp specified for flow rate with 70° water by correction factor to obtain required Δp for specified GPM at other temperature

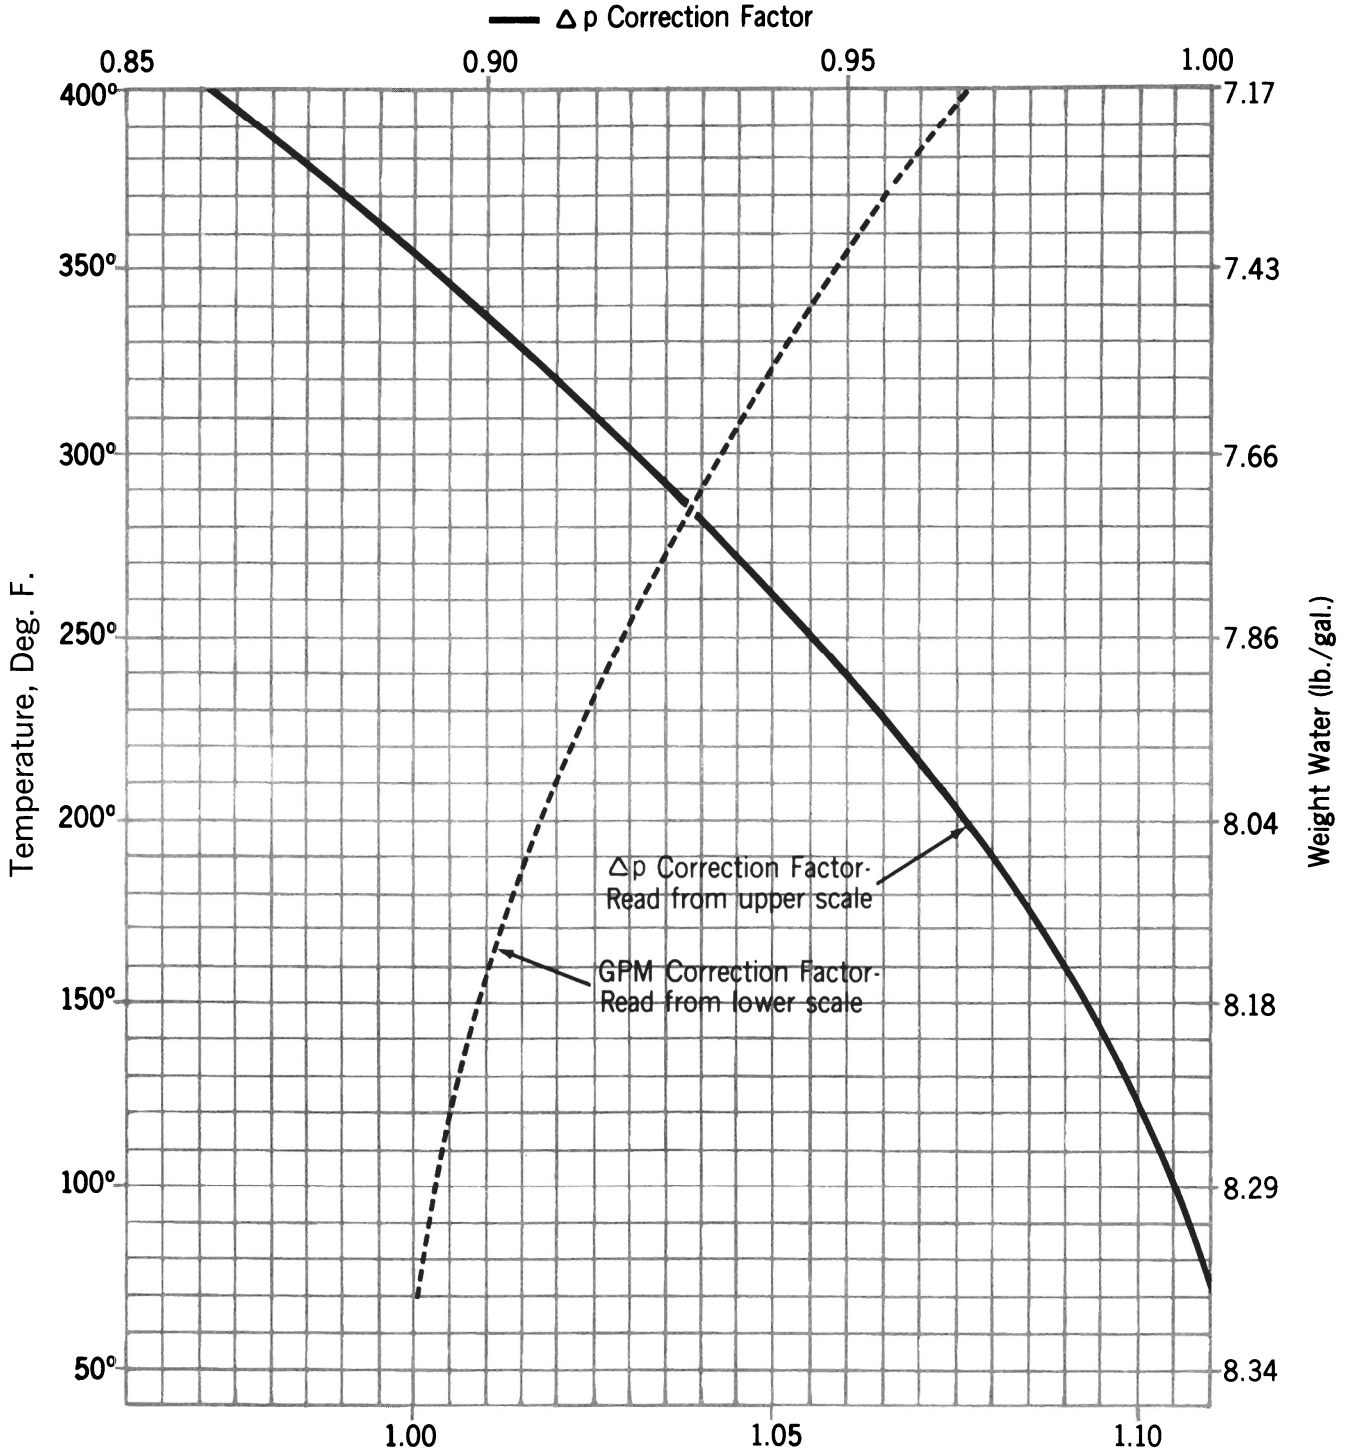

---- GPM Correction Factor
 Multiply GPM by correction factor to obtain actual GPM at temperature indicated.